


- ① **Monteringsveiledning kanaldekselet**
- ② **Monteringsanvisning kanalkåpa**
- ③ **Installation Instructions cover plate**

Art.nr./Art.no: 09863, 09864, 09865, 09866



For å lette monteringen av kanaldekselet skal avkast og uteluft isoleres med 25mm innenfor kanaldekselet. Etter kanaldekselet økes isolasjonen til 50mm. Tilluft og avtrekk trenger ikke isoleres innenfor kanaldekselet.

For ytterligere informasjon, se monteringsveiledningen for kanalsystem på [www.flexit.no](http://www.flexit.no)

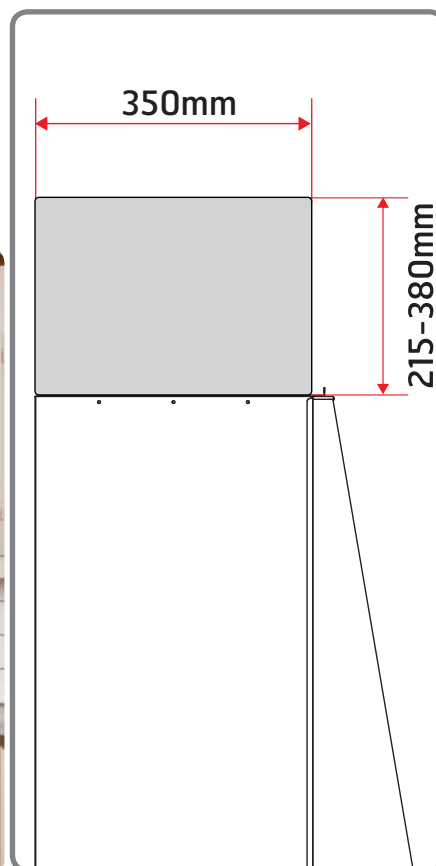

För att underlätta monteringen av kanalkåpa skall uteluft og avluft isoleras med 25mm inom kanalkåpa. Efter kanalkåpan ökas isolering till 50mm. Tilluft och frånluft behöver ingen isolering inom kanalkåpa.

För ytterligare information, se monteringsanvisning för kanalsystem [www.flexit.com](http://www.flexit.com)



To improve installation of duct cover, exhaust and outdoor air ducts shall be insulated with 25mm insulation behind the cover plate. After the cover plate it shall increase to 50mm. Supply air and extract air requires no insulation behind the cover plate.

For further information see installing instructions for duct systems at [www.flexit.no](http://www.flexit.no)